




PN - 1. nadstropje - nizkostenski profili začasno

| faze gradnje | oznaka | dolžina |
|--------------|--------|----------|
| 1. FAZA | TZ 01 | 128,01 m |
| 1. FAZA | TZ 02 | 8,73 m |

Legenda tlakov:

Legenda tlakov:

kuffner
G60-8

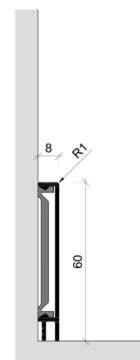

Detalji nizakostenske obloge TZ (2) v stensko obložitvi kot npr. Kueffner CAU-100-13-8

OPOMBA: Zahtevana ravnost končnega tlaka brušenega betona (TK 01) je definirana s standardom za ravnost tal DIN 18202 - tabela 3 po grupi 4.

Flatness Specification: DIN 18202 – Table 3

Table 3: Flatness tolerances

| Column | 1 | 2 | 3 | 4 | 5 | 6 |
|--------|--|--|-----|-----|------|--------|
| Group | Applicable to | Position deviations (limit values), in mm, for distances between measuring points, in m, up to | | | | |
| | | 0.1 | 1 * | 4 * | 10 * | 15 * † |
| 1 | unfinished upper surfaces of floors, subfloors and concrete bases | 10 | 15 | 20 | 25 | 30 |
| 2 | unfinished upper surfaces of floors, subfloors and concrete bases subject to more stringent requirements (e.g. to receive floating screed, industrial floors, tile flooring and bonded screed), and finished surfaces for minor purposes (e.g. in storerooms or basements) | 5 | 8 | 12 | 15 | 20 |
| 3 | finished floors (e.g. screed as wearing courses or screed to receive a flooring, trowelled or bonded floorings) | 2 | 4 | 10 | 12 | 15 |
| 4 | As group 3, but subject to more stringent requirements | 1 | 3 | 9 | 12 | 15 |
| 5 | unfinished walls and unfinished ceilings | 5 | 10 | 15 | 25 | 30 |
| 6 | finished walls and ceilings (e.g. plastered walls, wall claddings and linings, suspended ceilings) | 3 | 5 | 10 | 20 | 25 |
| 7 | As group 6, but subject to more stringent requirements | 2 | 3 | 8 | 15 | 20 |

* Intermediate values shall be taken from figures 1 and 2, and shall be given to the nearest millimetre.
† The flatness tolerances in column 6 also apply to distances between measuring points of over 15m.

* Intermediate values shall be taken from figures 1 and 2, and shall be given to the nearest millimetre.

† The flatness tolerances in column 6 also apply to distances between measuring points of over 15m.

| | |
|--|--|
| | |
| | |
| | |
| | |
| | |
| | |

SPREMENBESTYRIA
ARCHITEKTURA

T +386 (0)22 28 29 88
F +386 (0)22 28 29 89
E info@styria.si
STYRIA ARHITEKTURA D.O.O.
ČANKARJEVA ULICA 6E / SI-2000 MARIBOR
WWW.STYRIA.SI



ina
iren-Kostanjevica

$\pm 0,00 = +47,98$

OŠ Miren in postavitev nove telovadnice

objekt OSNOVNA ŠOLA MIRNI, Mirni 140
k.o. 2225 - MIRNI; parc. št. 622/3, 622/7, 622/8, 623/1, 623/10, 623/4, 623/5, 623/8, 624/2, 624/4, 626/1, 660/10, 660/5, 660/7, 660/11

Občina Miren-Kostanjevica

Miren 137, Miren - Slovenija

TLAKI

projekt PZI - Projekt za izvedbo

Tloris tlakov - nads

SEPTEMBER 2018

01/18

David MIŠIČ, Mag. Arch.

il projektant _____ David MIŠIČ, Mag. Arch.

projektant Jernej METEŽ, dipl.ing.građ.

projekt ID _____

medio 1:50, 1:1, 1:5

1:50, 1:1, 1:5  3.1.3
