

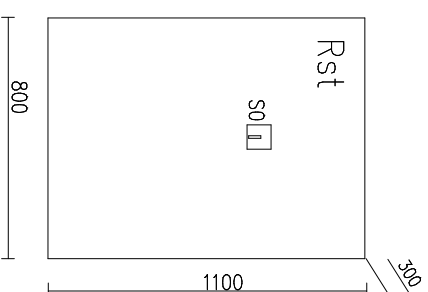
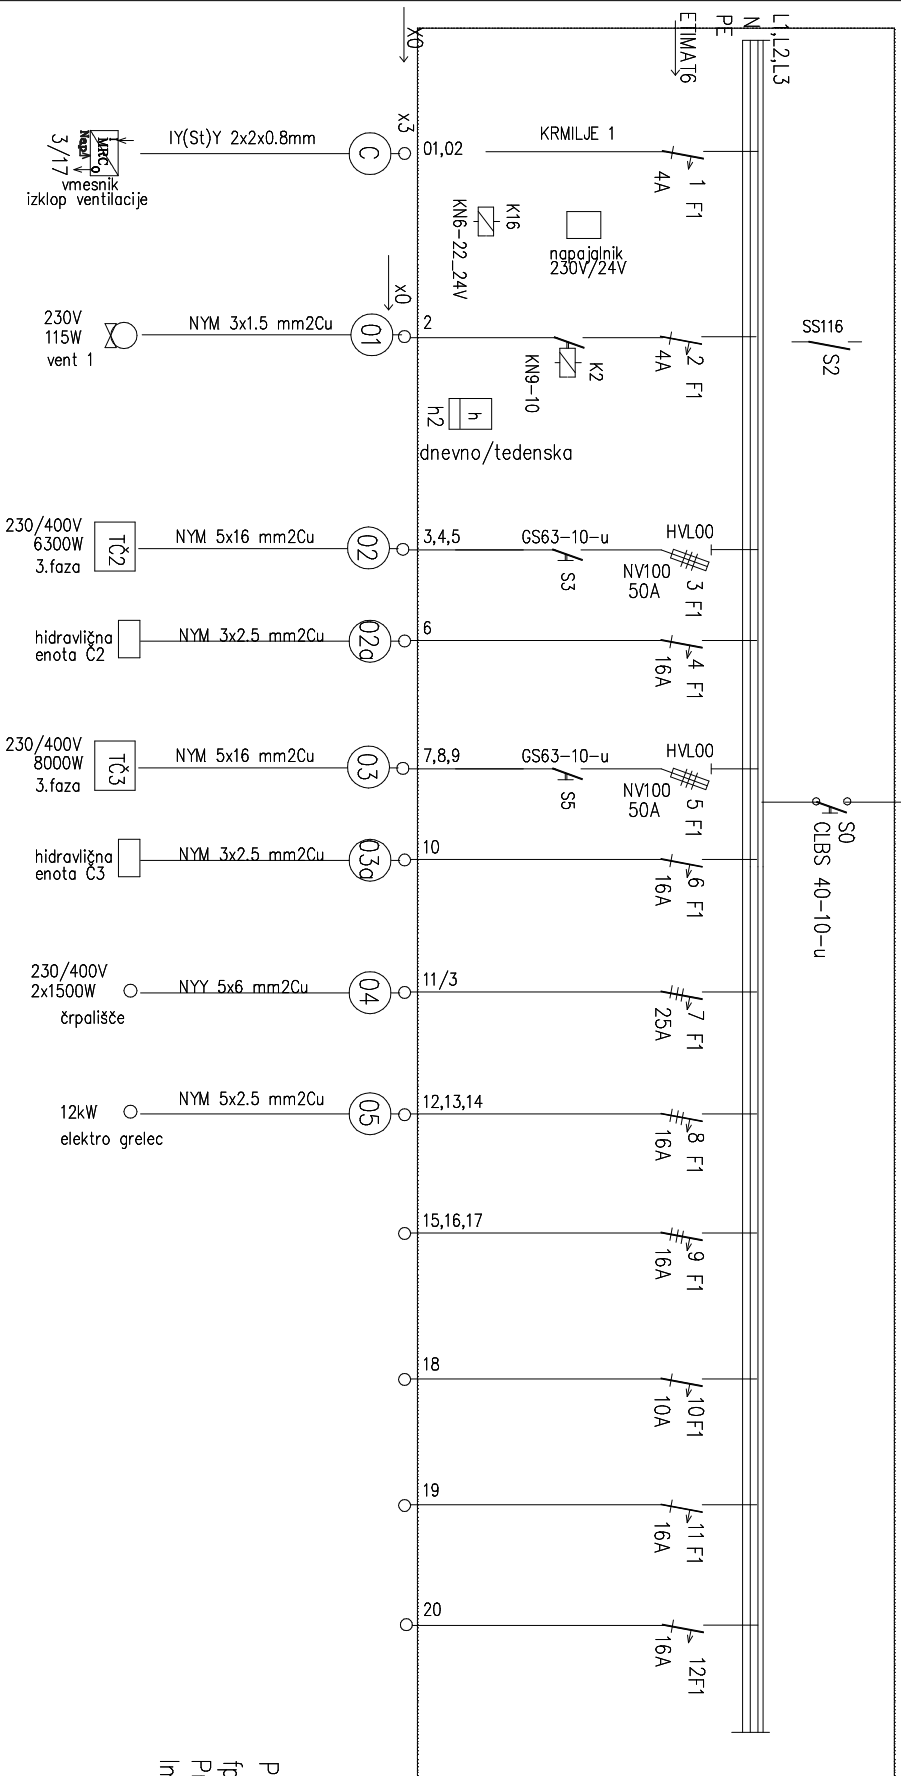
NYM 5x16mm2Cu

Rst

230/400 V; 3f,N,PE; 50 Hz

TN-S sistem zascite

ZASČITNA NAPRAVA NA ODKL. TOK


$$\begin{aligned} P_{\text{first}} &= 271000 \text{ W} \\ f_p &= 0,8 \\ P_{\text{max}} &= 21,600 \text{ W} \\ I_{\text{max}} &= 38,5 \text{ A } (\cos=0,9; \text{ } n=0,9) \end{aligned}$$

ENERKO d.o.o.									
INVESTITOR	OBČINA MIREN-KOSTANJEVICA				OBNOVA VODNA PROJEKTA	D. MIŠIČ	UDIA	PROJEKT	08.2018
	MIREN				ODG. PROJ. FAZE	E. KREJČNER	UDIE	ST.	
OBJEKT	OŠ MIREN + DOGRADITEV TELOVADNICE				PID – 1.FAZA			LIST:	28
	MIREN				TA LISTI NADOMESKA LISTI ST.				
NAČRT	ENOPOLNA SHEMA		BRNTO	FAZE	DATUM:		09.2020	LISTOV:	1
	Rst			E					

ENERKO d.o.o.