



R-CNS

230/400 V; 3f,N,PE; 50 Hz
TN-S sistem zosčite
ZASČITNA NAPRAVA NA ODKL. TOK

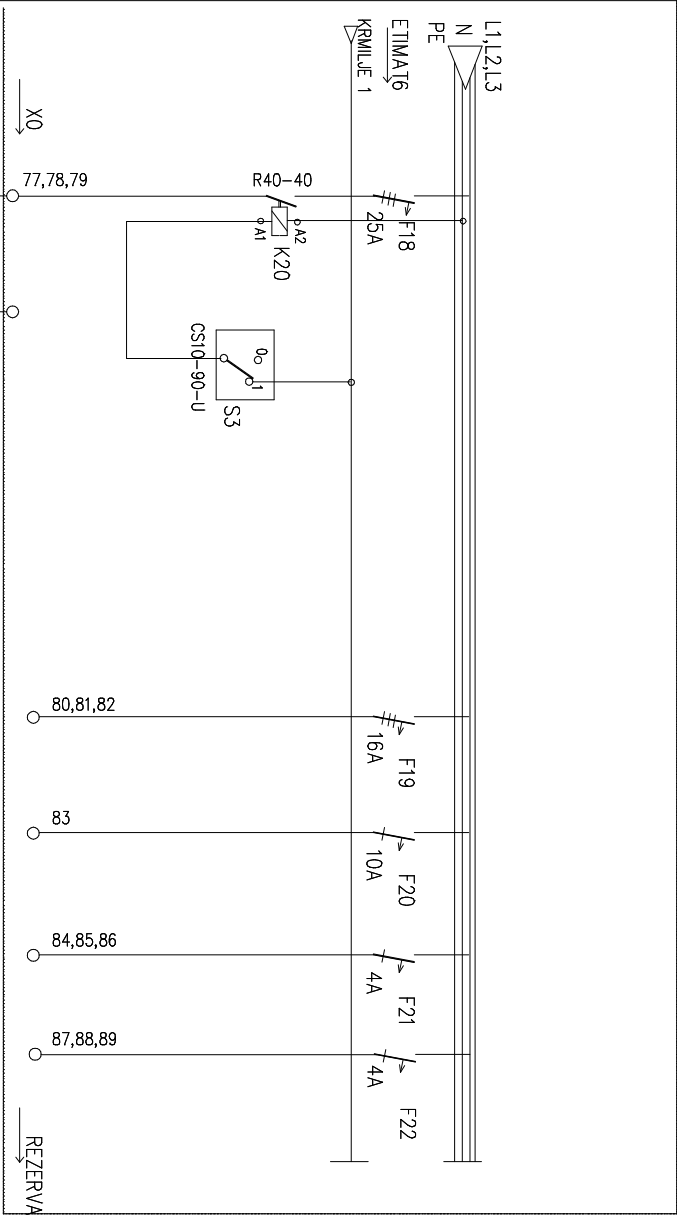

$P_{inst} = 21350W$
 $f_p = 0,9$
 $P_{max} = 19215 W$
 $I_{max} = 31,1 A \text{ (} \cos=0,95 \text{ } n=0,94 \text{)}$

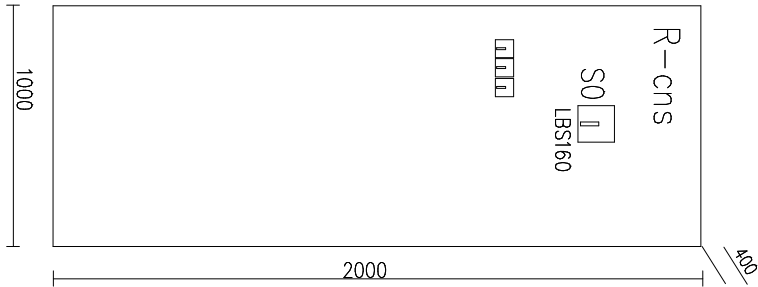

ENERKO d.o.o.									
INVESTITOR		OBJEKTA			ODGOV. VODJA PROJEKTA		D. MIŠIČ		UDIA
MIREN		MIREN			ODG. PROJ. FAZE		E. KREJNER		UDIE
OBJEKT		OŠ MIREN + DOGRADITEV TELOVADNICE			1A LIST NADOMESTJA LIST ST.		PID - 1.FAZA		
MAGRT		ENOPOLNA SHEMA R-CNS			VERZIO		FAZA		
					E		DATUM		09.2020
							LISTOV		4
							PROJEKT		08.2018
							UST:		29/4